

Grid-Associated Wind and Solar Cogeneration with Voltage Source Back-To-Back Converters

¹Aditya Jagtap, ²Prof. S. G. Kanade

¹Student, M.E., Power System, TSSM's Bhivarabai Sawant College of Engineering and Research, Pune, Maharashtra, India

²Professor, M.E., Power System, TSSM's Bhivarabai Sawant College of Engineering and Research, Pune, Maharashtra, India

Abstract - With developing concerns, in renewable energy sources can improve which is an increasing amount. This paper reviews both the vitality of the wind and the photovoltaic (PV) energy conversion strategies and their maximum-power-point tracking (MPPT) methods. Then, a new Grid tied wind PV cogeneration generation using back to back voltage source converters system is proposed. For the wind power generation permanent-magnet synchronous machine is used to capture the maximum wind power by using optimum speed control. For the PV power generation boost converter is adopted to harness the maximum solar power by tuning the duty cycle.

Keywords: AC-DC power converters, DC-AC power converters, maximum power point trackers, permanent magnet machines, solar power generation, wind power generation.

I. INTRODUCTION

The cost of the wind and solar energy generation has been rapidly falling since the last decade. Driven by their economic and technical incentives, the global installed capacity of photovoltaic (PV) and wind generators has approached 303 Giga watts (GW) and 487 GW in 2016, as compared to 6 GW and 74 GW in 2006, respectively. Due to the intermittent and unregulated nature of the wind and solar energy, power-electronic converters are utilized as an interfacing stage to the load-side or the utility-grid, and hence distributed generation units are created. In literature, most of the distributed generation systems are solely dedicated for one form of renewable resources, e.g., a solar energy as in or wind energy as in. In order to maximize the benefits of the available renewable resources, the combination of the wind and solar energy in the same vicinity has been considered. The grid-connected wind-PV cogeneration systems are not widely addressed. On the contrary, several wind-PV cogeneration systems are proposed for the stand alone off-grid applications. A stand alone wind-PV cogeneration system is proposed in. On the small-scale level, a single-phase cogeneration system has been proposed where as a laboratory-scale system is introduced in generally, the system structure in comprises a common dc-bus that interfaces several parallel connected converters-interfaced renewable energy resources, which

might reduce the overall system efficiency and increase the cost [12]. More importantly, the cascaded connection of power converters requires rigorous controller's coordination to avoid the induced interactions dynamics, which might yield instabilities.

A back-to back (BtB) voltage-source converter (VSC) connected to a doubly-fed induction generator is used to interface a dc-DC converter-interfaced PV generator and an energy storage unit in. In, a PV generator charging a battery bank and interfaced to a wind driven induction generator via a VSC is proposed. The wind-PV cogeneration systems in highlights the efficient integration of the renewable energy resources with the minimal utilization of power-electronic conversion stages. However, these systems are proposed for specific off-grid applications. In, the utility-grid integration of the renewable energy resources has been improved by using multiple-input converters. A buck/buck-boost fused dc-dc converter is proposed in. A dc-dc converter with a current-source interface and a coupled transformer is proposed in and, respectively. However, the proposed systems in are based on the dc power distribution which might not be the ideal distribution medium in the ac-dominated power systems. Upto the authors' best knowledge, the combination of the grid-connected wind-PV systems has been solely addressed in. The system in comprises a BtB VSCs to interface the PV and wind generators to the utility-grid. On the machine-side-VSC, the dc-link voltage is regulated to the maximum Power point tracking (MPPT) value of the PV panels by an outer loop proportional-and-integral (PI) dc voltage controller. The reference values of the machine-side currents are calculated using the synchronous detection method, and a hysteresis current controller is utilized for the regulation. On the grid-side-VSC, a hysteresis grid-current controller is used to inject the total currents into the utility-grid. In spite of the potential benefits of the proposed system.

II. METHODOLOGY

The proposed system consists of a VSR to interface the wind generator, and a VSI to connect the cogeneration system into the utility-grid as shown in fig 1.

The PV generator is directly connected to the dc-link capacitor of the BtB VSCs via a dc cable [27]. The VSR and VSI are two-level converters consisting of six cells; each comprises an insulated-gate-bipolar transistor (IGBT) in parallel with a diode. In the following subsections, the complete modeling and control of the proposed system is provided.

A full-scale wind turbine (FSWT) utilizing a permanent magnet synchronous generator (PMSG) is elected for its low maintenance and low operational cost [2].

The wind turbine model is represented as following, where P'' is the mechanical power captured by the wind turbine blades; C' is the rotor coefficient which is a non-linear function of the blade pitch angle (δ) and the tip-speed ratio (λ); ρ is the air density; R is the radius of the wind turbine blade; v is the wind speed; and ω is the mechanical speed of the rotor. In this paper, δ is set to zero in the normal operating conditions to maximize the wind power generation [13]. The PMSG is modeled as following,

$$P_m = \frac{1}{2} C_p(\delta, \lambda) \rho \pi R^2 v_{wind}^3$$

$$\lambda = \frac{R\omega_r}{v_{wind}} \tag{1}$$

$$\bar{v}_s = R_s \bar{i}_s + L_s \frac{d\bar{i}_s}{dt} + jP\omega_r(\psi + L_s \bar{i}_s) \tag{2}$$

$$J \frac{d}{dt} \omega_r + \beta \omega_r = \frac{3}{2} P \psi I_{sq} - T_m \tag{3}$$

In (2), \bar{v}_s and \bar{i}_s are the stator voltage and current in the complex vectors representation.

$$\bar{x} = X_d + jX_q$$

Where a complex vector such that X_d and X_q are the direct (d -) and quadrature (q -) components of \bar{x} in the rotating reference frame; R_A and L_A are the stator-winding resistance and inductance, respectively; j is the imaginary unit number; ψ is the flux linkage of the rotor magnets; P is the number of poles pairs; T'' is the mechanical torque; whereas J and β are the motor inertia, and viscous friction, respectively.

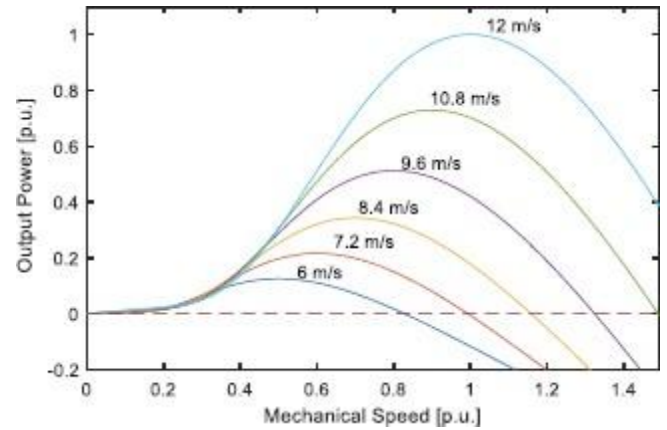


Figure 1: Mechanical characteristics of the wind turbine at different wind speeds




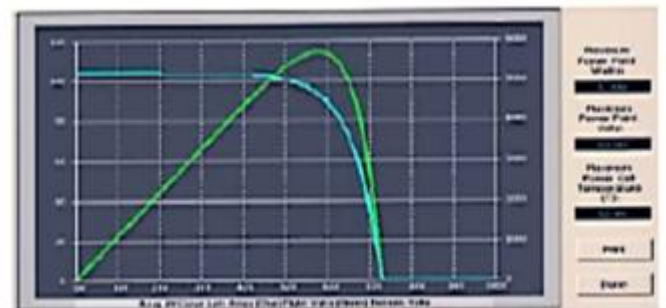


Figure 2: Implementation

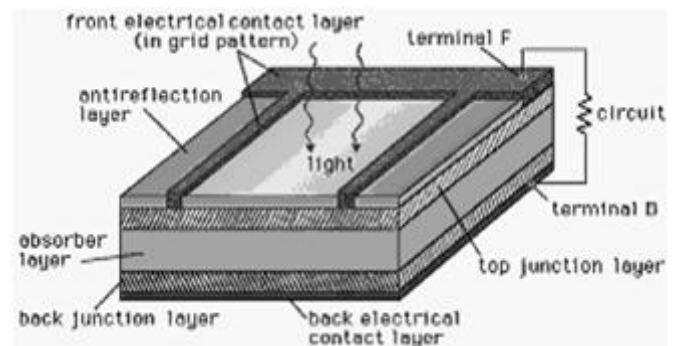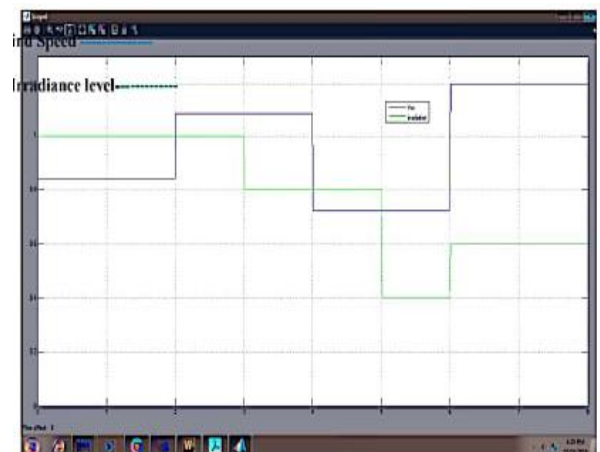

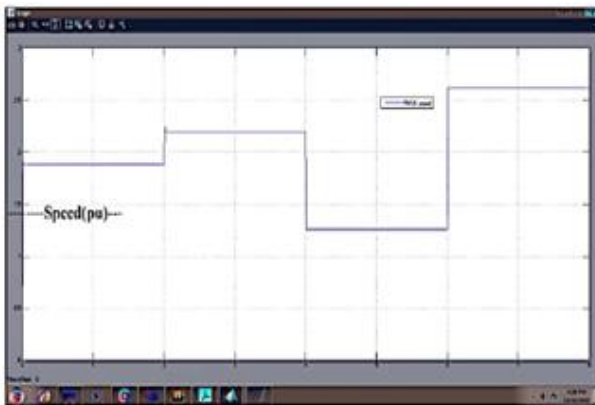

III. RESULTS AND CONCLUSION

This paper has introduced the breeze PV cogeneration frameworks utilizing vector-controlled network associated BtB VSCs. The VSR at the breeze generator-side is answerable for separating the most extreme breeze power following the breeze speed varieties. On the utility-framework side, the jobs of the VSI are to extricate the most extreme PV power from the PV generator, accomplish the harmony between the info yield powers across the dc-connect capacitor, and to keep a solidarity PCC voltage under various methods of activity. A little sign dependability investigation has been directed for the whole framework.

REFERENCES

- [1] RenewableEnergyPolicyNetworkforthe21stCentury, "Advancingtheglobalrenewableenergytransition," REN21 Secretariat, Paris, France, 2017 [Available Online].
- [2] F. Blaabjerg, Z. Chen, and S. B. Kjaer, "Power electronics as efficient interface in dispersed power generation systems," *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1184-1194, 2004.
- [3] J. Carrasco et al., "Power-electronic systems for the grid integration of renewable energy sources-a survey," *IEEE Trans. Ind. Electron.*, vol.53, no. 4, pp. 1002-1016, 2006.
- [4] A. Yazdani and P. P. Dash, "A control methodology and characterization of dynamics for a photovoltaic (PV) system interfaced with a distribution network," *IEEE Trans. Power Electron.*

- [5] L. Nousiainen, J. Puukko, A. Maki, T. Messo, J. Huusari, J. Jokipii, J. Viinamaki, D. Lobera, S. Valkealahti, and T. Suntio, "Photovoltaic generator as an input source for power electronic converters," *IEEE Trans. Power Electron.*, vol.28, no.6, pp.3028-3038, 2013.
- [6] Nicholas Strachan, and D. Jovcic, "Stability of a variable-speed permanent magnet wind generator with weak ac grids," *IEEE Trans. Power Del.*, vol. 25, no.4, pp.2279-2788, 2010.
- [7] P. Mitra, L. Zhang, and L. Harnefors, "Offshore wind integration to a weak grid by VSC-HVDC links using power-synchronization control – a case study," *IEEE Trans. Power Del.*, vol.29, no. 1, pp. 453-461, 2014.
- [8] Y. Wang, J. Meng, X. Zhang and L. Xu, "Control of PMSG-based wind turbines for system inertial response and power oscillation damping," *IEEE Trans. Sustain. Energy*, vol.6, no. 2, pp. 565-574, 2015.
- [9] F. Giraud, "Analysis of a utility-interactive wind-photovoltaic hybrid system with battery storage using neural network," Ph.D. dissertation, Univ. Mass., Lowell, 1999.
- [10] L. Xu, X. Ruan, C. Mao, B. Zhang, and Y. Luo, "An improved optimal sizing method for wind-solar-battery hybrid power system," *IEEE Trans. Sustain. Energy*, vol. 4, no. 3, pp.774-785, 2013.
- [11] S. Sarkar and V. Ajjarapu, "MW resource assessment model for a hybrid energy conversion system with wind and solar resources," *IEEE Trans. Sustain. Energy*, vol. 2, no.4, pp. 383-391, 2011.
- [12] Y.-M. Chen, Y.-C. Liu, S.-C. Hung, and C.-S. Cheng, "Multi-input inverter for grid-connected hybrid PV/wind power system," *IEEE Trans. Power Electron.*, vol. 22, no. 3, pp.1070-1077, 2007.

AUTHOR'S BIOGRAPHY



Aditya Jagtap, Student, M.E., Power System, TSSM's Bhivarabai Sawant College of Engineering and Research, Pune, Maharashtra, India.

Citation of this Article:

Aditya Jagtap, Prof. S. G. Kanade, "Grid-Associated Wind and Solar Cogeneration with Voltage Source Back-To-Back Converters" Published in *International Research Journal of Innovations in Engineering and Technology - IRJIET*, Volume 6, Issue 4, pp 115-117, April 2022. Article DOI <https://doi.org/10.47001/IRJIET/2022.604025>
